

VISUAL COMFORT AND COMPANY TEST REPORT

SCOPE OF WORK

Performance Testing for Luminaires

MODEL NUMBER

E3SRF-LO9306A w/ E3SLB-OW

PROJECT NUMBER

G104622548

REPORT NUMBER

104622548CRT-008

ISSUE DATE

9/21/2021

REVISED DATE

None

TEST DATES

9/17/21 through 9/21/21

DOCUMENT CONTROL NUMBER

RTTDS-R-AMER-Test-3407

© 2017 INTERTEK



REPORT NUMBER

104622548CRT-008

MODEL NUMBER(s)

E3SRF-LO9306A w/ E3SLB-OW

REPORT RENDERED TO:

VISUAL COMFORT AND COMPANY
7400 LINDER AVE
SKOKIE, IL 60077
USA

STATEMENT OF LIMITATION

NVLAP Lab Code 100402-0. This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government.

AUTHORIZATION

The testing performed was authorized by signed quote number Qu-01154433-0.

TEST STANDARDS


IESNA LM-79 - 2008: Electrical and Photometric Measurements of Solid State Lighting
ANSI NEMA ANSLG C78.377: 2017: Specifications of the Chromaticity of Solid State Lighting Products

In Charge of Testing:



Gerald Gray
Associate Engineer
Lighting Division

Reviewer:



Kristie Ray
Team Lead, Engineering
Lighting Division

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

SAMPLE INFORMATION

REPORT NO. 104622548CRT-008


ITEMS RECEIVED

Item No.	Control No.	Model No.	Description	Type	Received
1	CRT2109100744-001-1	--	Housing w/PTB15W-0300-38-VCC	Production	9/10/2021
2	CRT2109100744-001-9	--	3000K LED	Production	9/10/2021
3	CRT2109100744-001-18	--	60° Lens	Production	9/10/2021
4	CRT2109100744-001-19	--	Trim with Lens	Production	9/10/2021

TESTED SAMPLE CONFIGURATIONS

Config No.	Tested Model No.	Item Nos. Utilized
1	E3SRF-LO9306A w/ E3SLB-OW	1,2,3,4

SAMPLE PHOTOS - TESTED CONFIGURATIONS

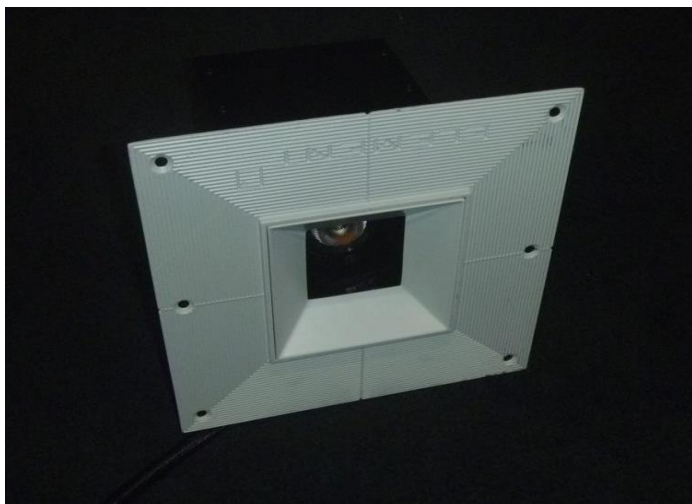

SUMMARY

REPORT NO. 104622548CRT-008

PRODUCT INFORMATION AND SUMMARY OF DATA

Product Model No.:	E3SRF-LO9306A w/ E3SLB-OW
Product Description:	E3 IC REMODEL-930-60DEG-NO LENS
LED Model No.:	Bridgelux® Gen 8 V10 Array Series
Driver Model No.:	PTB15W-0300-38-VCC
Light Source:	LED
CEC Product Type:	Inseparable

Criteria	Results
Light Output (lumens)	826.9
Input Power (W)	11.10
Lumen Efficacy (lm/W)	74.5
Input Power Factor ()	0.987
Correlated Color Temperature (K)	2949
Color Rendering Index - Ra ()	91.4
Color Rendering Index - R9 ()	70.4
Duv ()	-0.0010
Chromaticity Coordinate (x)	0.439
Chromaticity Coordinate (y)	0.402
Chromaticity Coordinate (u')	0.253
Chromaticity Coordinate (v')	0.521

TEST METHODS

SEASONING IN SAMPLE ORIENTATION - LED PRODUCTS

No seasoning was performed in accordance with IESNA LM-79.

INTEGRATING SPHERE TESTING

A spectroradiometer and integrating sphere were used to measure the spectral distribution for each EUT resulting in photometric and colorimetric data. Electrical measurements of the unit were measured using a power analyzer. Each EUT was operated at the rated input voltage of the system in its designated orientation. The ambient temperature was measured at a position inside the sphere and stabilization procedures to LM-79 were followed.

TYPE C GONIOPHOTOMETER DISTRIBUTION TESTING

A Type C Mirror Goniophotometer system was used to measure the luminous intensity (candela) at each angle of distribution for the EUT. Electrical measurements of the unit were measured using a power analyzer. Each EUT was operated at the rated input voltage of the system in its designated orientation. The ambient temperature was measured at a position near the EUT at equal height and stabilization procedures to LM-79 were followed.

TYPE C GONIOPHOTOMETER DISTRIBUTION TESTING

REPORT NO. 104622548CRT-008

Test Configuration	Tested Model No.	Pass/Fail/NA
1	E3SRF-LO9306A w/ E3SLB-OW	NA

PHOTOMETRIC AND ELECTRICAL MEASUREMENTS (25°C +/- 1°C)


Base Orientation	Input Voltage (Vac)	Input Current (mA)	Input Power (W)	Input Power Factor ()
Up	120.02	93.0	11.04	0.989

Light Output (lm)	Lumen Efficacy (lm/W)
796.9	72.2

INTENSITY SUMMARY - CANDELA

Angle	0	22.5	45	67.5	90
0	1046	1046	1046	1046	1046
5	1045	1046	1040	1033	1023
10	1011	1005	997	982	960
15	935	928	915	896	870
20	827	818	800	776	745
25	660	662	651	598	550
30	449	469	483	410	351
35	226	263	307	221	184
40	131	141	169	127	115
45	72	83	80	78	66
50	0	19	41	11	0
55	0	0	10	0	0
60	0	0	0	0	0
65	0	0	0	0	0
70	0	0	0	0	0
75	0	0	0	0	0
80	0	0	0	0	0
85	0	0	0	0	0
90	0	0	0	0	0
95	0	0	0	0	0
100	0	0	0	0	0
105	0	0	0	0	0
110	0	0	0	0	0
115	0	0	0	0	0
120	0	0	0	0	0
125	0	0	0	0	0
130	0	0	0	0	0
135	0	0	0	0	0
140	0	0	0	0	0
145	0	0	0	0	0
150	0	0	0	0	0
155	0	0	0	0	0
160	0	0	0	0	0
165	0	0	0	0	0
170	0	0	0	0	0
175	0	0	0	0	0
180	0	0	0	0	0

Entire luminous intensity matrix found in .IES file

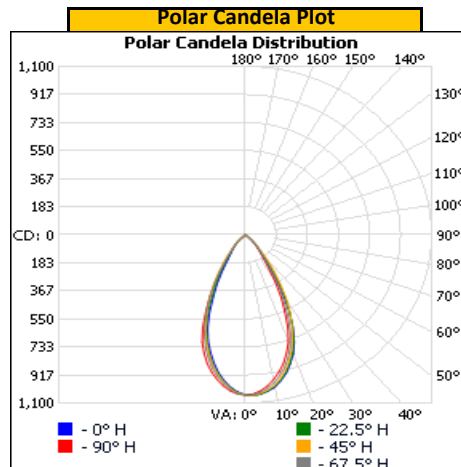



REPORT NO. 104622548CRT-008

ORIENTATION AND ALIGNMENT OF EUT

Luminous Opening		
Length (ft)	Width (ft)	Height (ft)
0.29	0.29	0.00
0°-180° H	90°-270° H	0°-180° V


Test Distance (ft)
29.6

PHOTOMETRIC CENTER OF EUT

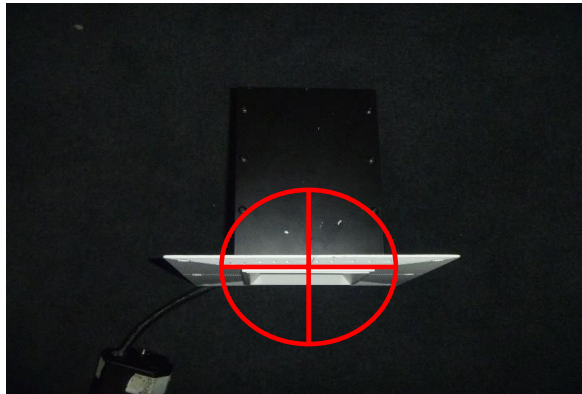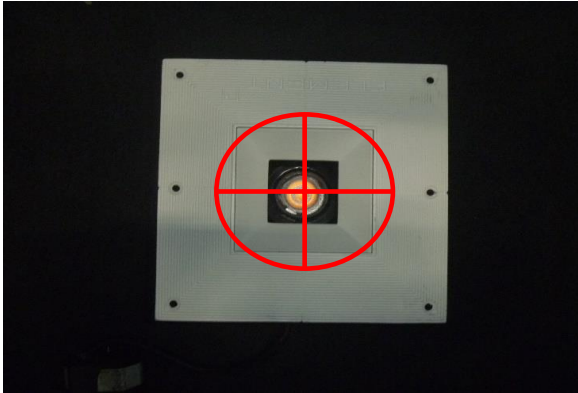

REPORT NO. 104622548CRT-008

ILLUMINANCE SUMMARY

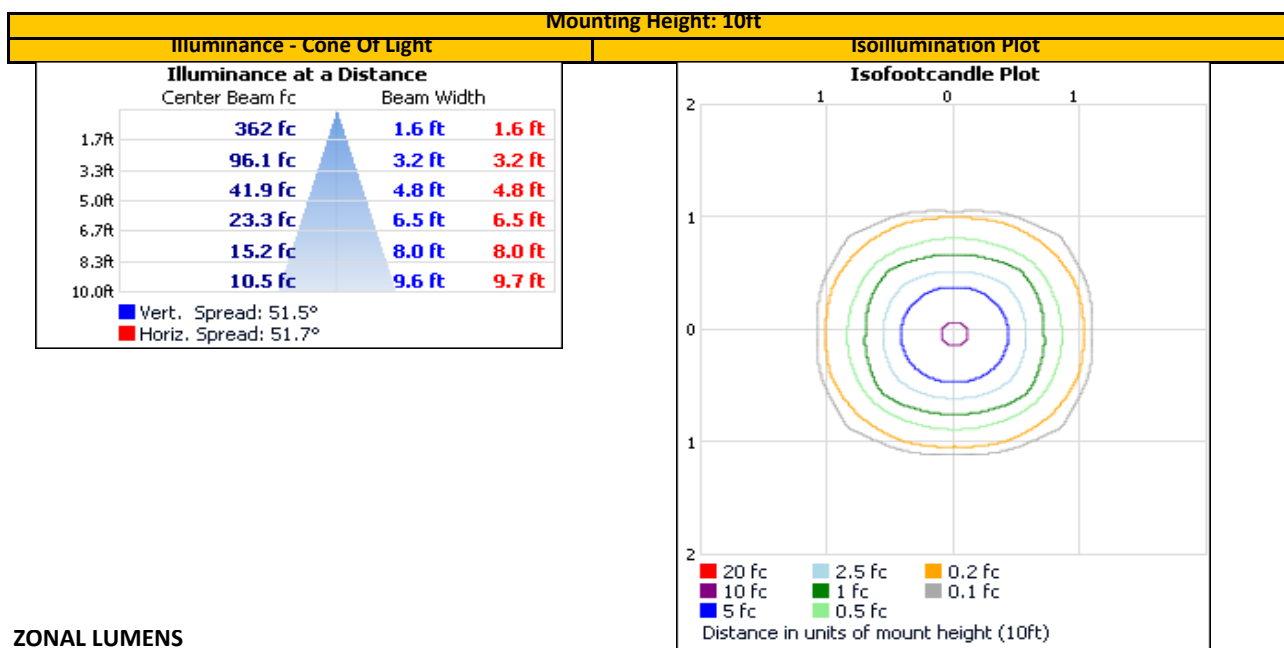

ZONAL LUMENS

Zonal Lumen Summary								
Zone	Lumens	% Lum	Zone	Lumens	% Total	Zone	Lumens	% Total
0-30	594.6	74.6%	0-10	95.6	12.0%	90-100	0.0	0.0%
0-40	739.5	92.8%	10-20	240.8	30.2%	100-110	0.0	0.0%
0-60	796.9	100.0%	20-30	258.2	32.4%	110-120	0.0	0.0%
60-90	0.0	0.0%	30-40	144.8	18.2%	120-130	0.0	0.0%
70-100	0.0	0.0%	40-50	53.8	6.8%	130-140	0.0	0.0%
90-120	0.0	0.0%	50-60	3.6	0.4%	140-150	0.0	0.0%
0-90	796.9	100.0%	60-70	0.0	0.0%	150-160	0.0	0.0%
90-180	0.0	0.0%	70-80	0.0	0.0%	160-170	0.0	0.0%
0-180	796.9	100.0%	80-90	0.0	0.0%	170-180	0.0	0.0%

INTEGRATING SPHERE TESTING

REPORT NO. 104622548CRT-008

Test Configuration	Tested Model No.	Pass/Fail/NA
1	E3SRF-LO9306A w/ E3SLB-OW	NA


PHOTOMETRIC, COLORIMETRIC, AND ELECTRICAL MEASUREMENTS (25°C +/- 1°C)

Base Orientation
Up

Input Voltage (Vac)	Input Current (mA)	Input Power (W)	Input Power Factor ()	Input ATHD (%)
120.04	93.7	11.10	0.987	11.05
277.04	43.8	10.91	0.900	14.95

Light Output (lm)	Lumen Efficacy (lm/W)	CCT (K)	CRI - Ra ()	CRI - R9 ()
826.9	74.5	2949	91.4	70.4


Duv ()	1931 Chrom (x)	1931 Chrom (y)	1976 Chrom (u')	1976 Chrom (v')
-0.0010	0.439	0.402	0.253	0.521

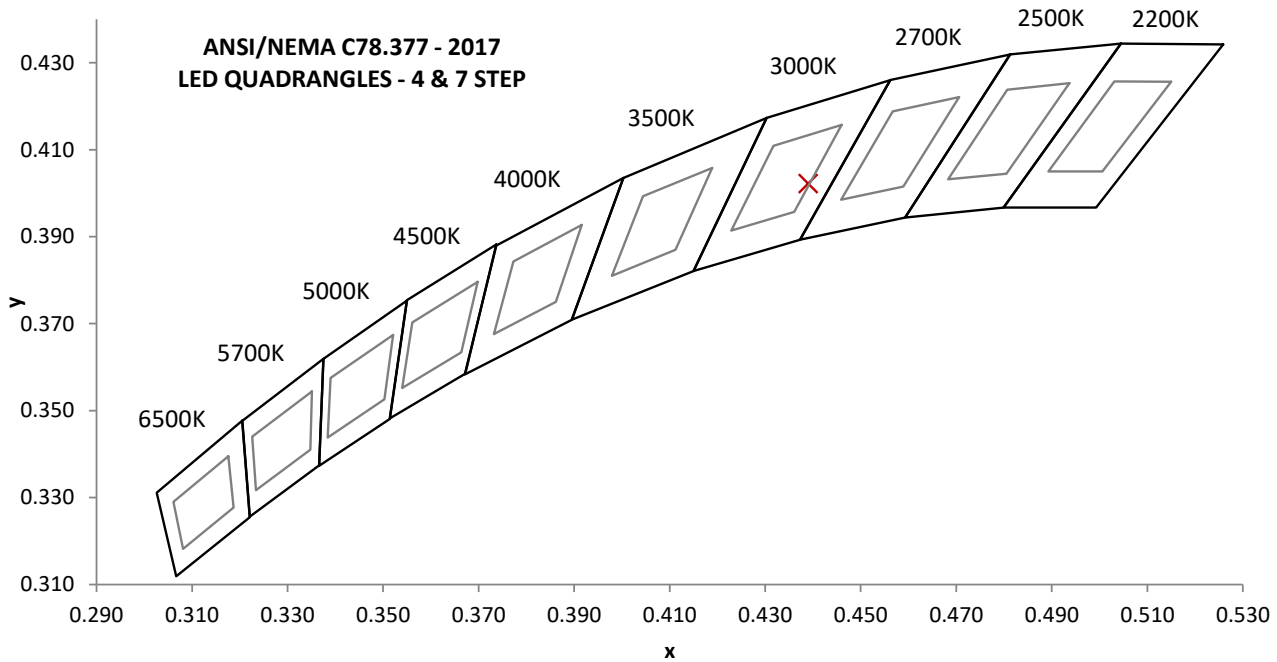

REPORT NO. 104622548CRT-008

SPECTRAL DISTRIBUTION OVER WAVELENGTHS

nm	mW/nm		nm	mW/nm		nm	mW/nm		nm	mW/nm
350	0.2		460	4.7		570	12.2		680	10.0
355	0.1		465	3.7		575	12.5		685	9.0
360	0.1		470	2.8		580	12.8		690	8.1
365	0.1		475	2.3		585	13.1		695	7.2
370	0.1		480	2.4		590	13.5		700	6.4
375	0.1		485	2.7		595	14.1		705	5.6
380	0.1		490	3.3		600	14.7		710	4.9
385	0.1		495	4.2		605	15.3		715	4.4
390	0.1		500	5.1		610	15.8		720	3.8
395	0.2		505	6.0		615	16.3		725	3.3
400	0.2		510	6.9		620	16.7		730	2.9
405	0.2		515	7.7		625	16.8		735	2.5
410	0.3		520	8.3		630	16.9		740	2.2
415	0.5		525	8.9		635	16.7		745	1.9
420	0.9		530	9.5		640	16.4		750	1.6
425	1.5		535	10.0		645	16.0		755	1.4
430	2.4		540	10.4		650	15.4		760	1.2
435	3.6		545	10.8		655	14.7		765	1.0
440	5.2		550	11.2		660	13.8		770	0.9
445	7.7		555	11.5		665	12.9		775	0.8
450	9.1		560	11.8		670	11.9		780	0.7
455	6.7		565	12.0		675	10.9		---	---

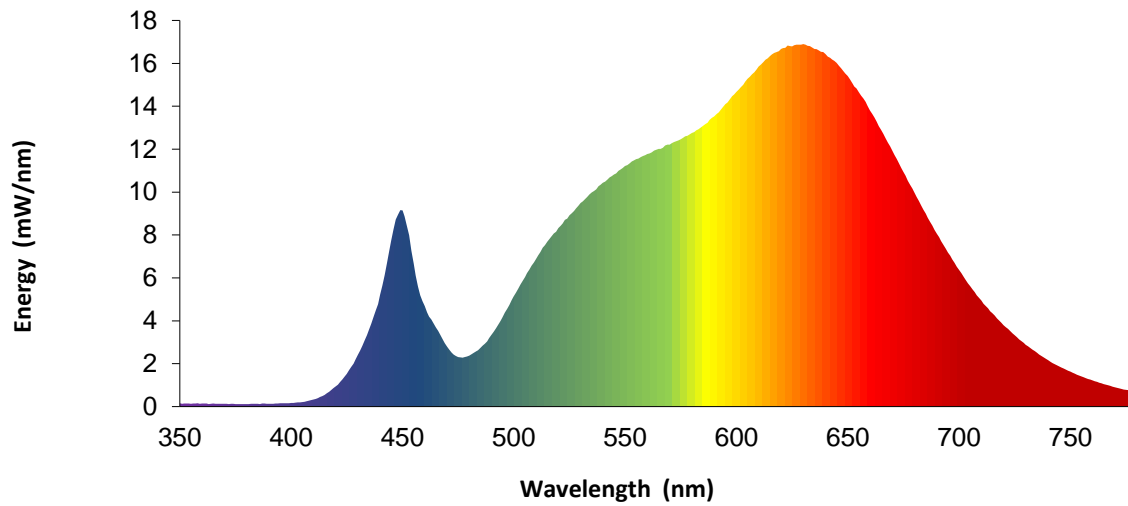

Portrayed color in graphic is estimated by wavelength (nm) and may not be exact - it is a visual representation only

REPORT NO. 104622548CRT-008







ANSI/IES TM-30-18 Color Rendition Report

Source: LED

Manufacturer VISUAL COMFORT AND COMPANY

Date: 9/21/2021

Model: E3SRF-LQ9306A w/ E3SLB-QW

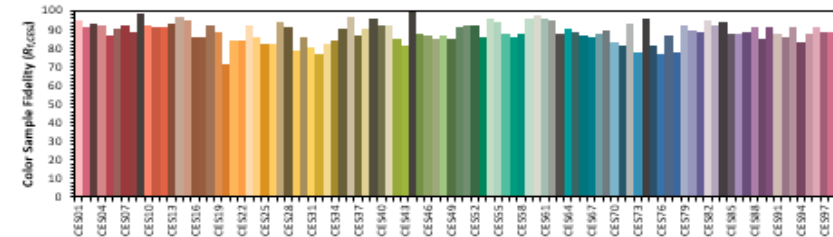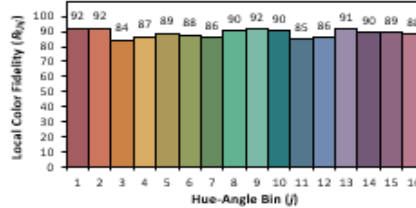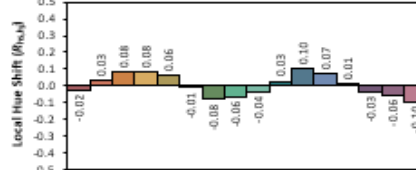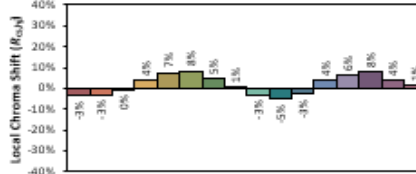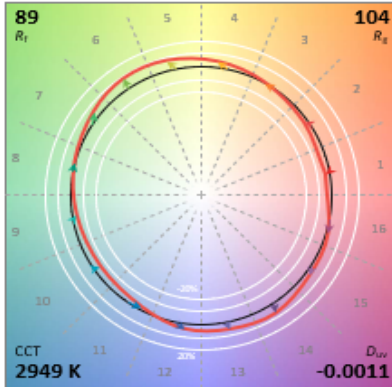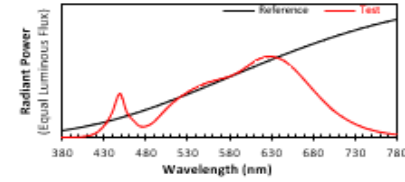

Notes: This is a recommended method for displaying ANSI/IES TM-30-18 information.

R_e 0.4390
 R_g 0.4021
 R_a 0.2528
 R_s 0.5209

CIE 13.3-1995
(CRI)
 R_a 91
 R_g 71

Colors are for visual orientation purposes only. Created with the ANSI/IES TM-30-18 Calculator Version 2.00.

EQUIPMENT LIST

REPORT NO. 104622548CRT-008

#	Equipment	Model No	Control No.	Last Cal	Cal Due
1	Elgar AC Power Supply	CW1251	---	VBV	VBV
2	Sorenson DC Power Supply	XFR 150-8	---	VBV	VBV
3	Traceable Hygrothermometer	4800	L206	2/12/2021	2/12/2022
4	Yokogawa Power Analyzer	WT1600	E474	6/15/2021	6/15/2022
5	Fluke Thermometer	53 II	D587	2/5/2021	2/5/2022
6	3M Integrating Sphere Spectrometer System	CDS 2600	---	9/3/2021	12/3/2021
7	Fisher Scientific Stopwatch	14-649-9	N1132	3/26/2021	3/26/2022
8	LSI High Speed Mirror Goniophotometer	6440	---	8/16/2021	11/16/2021
9	Elgar AC Power Supply	CW1251	---	VBV	VBV
10	Yokogawa Power Analyzer	WT210	E464	5/11/2021	5/11/2022
11	Traceable Hygrothermometer	4800	L204	2/21/2021	2/21/2022
12	Sorenson DC Power Supply	XG 150-10	---	VBV	VBV
13	Omega Thermometer	DPI8-C24	M263	3/23/2021	3/23/2022
14	Bosch Distance Laser	Pro GLM 20	L211	3/3/2021	3/3/2022
15	M-D Building Products Digital Level	Smart Tool	L112	5/26/2021	5/26/2022
16	Tape Measure	Powerlock	N1342	3/11/2019	3/11/2022

REVISION HISTORY

#	Revision Date	Updated By	Reviewed By	Description of Change
---	None	---	---	---
---	---	---	---	---
---	---	---	---	---